

SystemLex Control Wiring.

'Live' & 'Neutral' Tracks already exist on the SystemLex and need not be installed

'Lex-Links' already exist on the SystemLex and need not be installed

Isolated Power Supply

5amp

Live Track

Neutral Track

Clock F5

3 amp

51

Time Control

N.O.

Com.

N.C.

Lex-link

12

13

Room Stat

N.O.

Com.

N.C.

Lex-link

22

23

Room Stat

N.O.

Com.

N.C.

Lex-link

32

33

Cylinder Stat

N.O.

Com.

N.C.

81

Lex-link

34

35

Pump

L

N

16

N

Lex-link

14

15

Pump

L

N

26

N

Lex-link

24

25

Pump

L

N

36

N

52

AUX Outputs

NO2

CM2

NC2

74

75

76

ASHP and Pump

56

Boiler 1

F6

3 amp

53

Control Boiler 1

61

62

5° Ambient Stat

N.O.

Com.

N.C.

Manual Switch


82

Boiler and Pump

1

54

Boiler requiring Switch Live supply

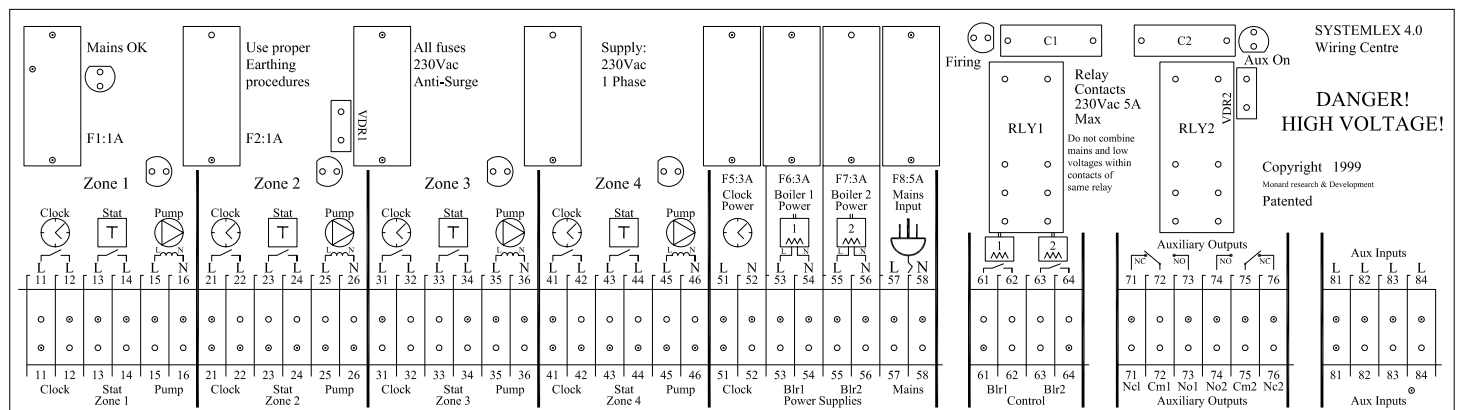

Date: 07-03-2017

To aid diagram clarity, EARTH connections are not shown but must be installed in accordance with manufacturers instructions