

SystemLex Control Wiring.

'Live' & 'Neutral' Tracks already exist on the SystemLex and need not be installed
 'Lex-Links' already exist on the SystemLex and need not be installed
 'Installer-Links' MUST be fitted by the installing engineer

Isolated Power Supply

5amp

Live Track

Neutral Track

Clock F5

3 amp

51

Time Control

N.O.

Com.

N.C.

N.O.

Com.

N.C.

N.O.

Com.

N.C.

Lex-link

12 13

Room Stat

N.O.

Com.

N.C.

Lex-link

22 23

Room Stat

N.O.

Com.

N.C.

Lex-link

32 33

Cylinder Stat

N.O.

Com.

N.C.

Lex-link

14 15

Pump

N

16

Lex-link

24 25

Pump

N

26

Lex-link

34 35

Pump

N

36

N

52

Wood Pellet Boiler

F6

3 amp

53

Control Boiler 1

Installer-link

61 62

Boiler requiring Switch Live supply

Boiler and Pump

1

54

L

N

Oil Boiler

F7

3 amp

55

Control Boiler 2

Installer-link

63 64

Optional 2nd. boiler requiring Switch Live supply


Boiler and Pump

2

56

L

N

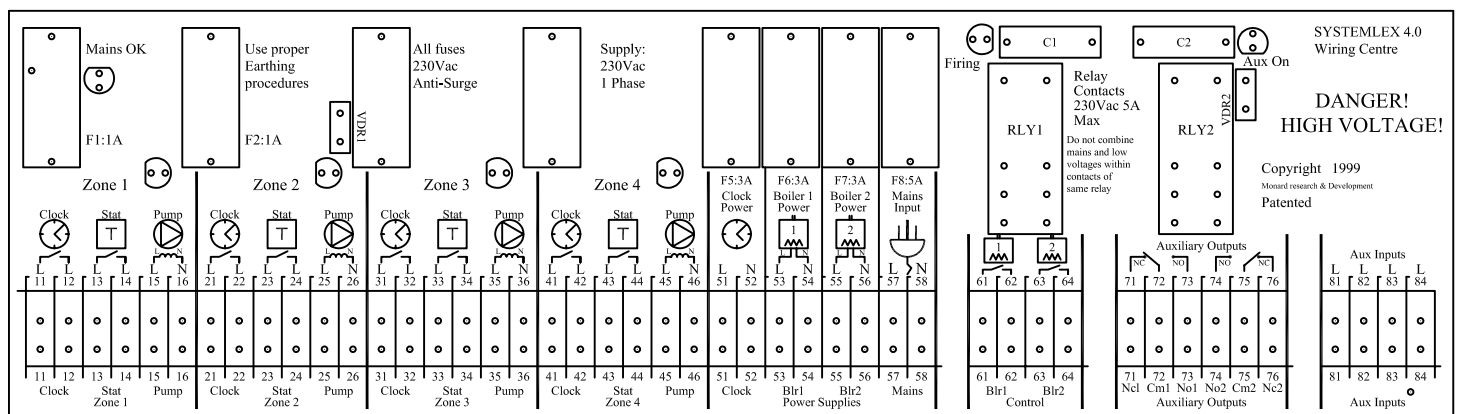

Date: 08-07-08

To aid diagram clarity, EARTH connections are not shown but must be installed in accordance with manufacturers instructions