


SystemLex Control Wiring.

'Live' & 'Neutral' Tracks already exist on the SystemLex and need not be installed
'Lex-Links' already exist on the SystemLex and need not be installed
'Installer-Links' MUST be fitted by the installing engineer

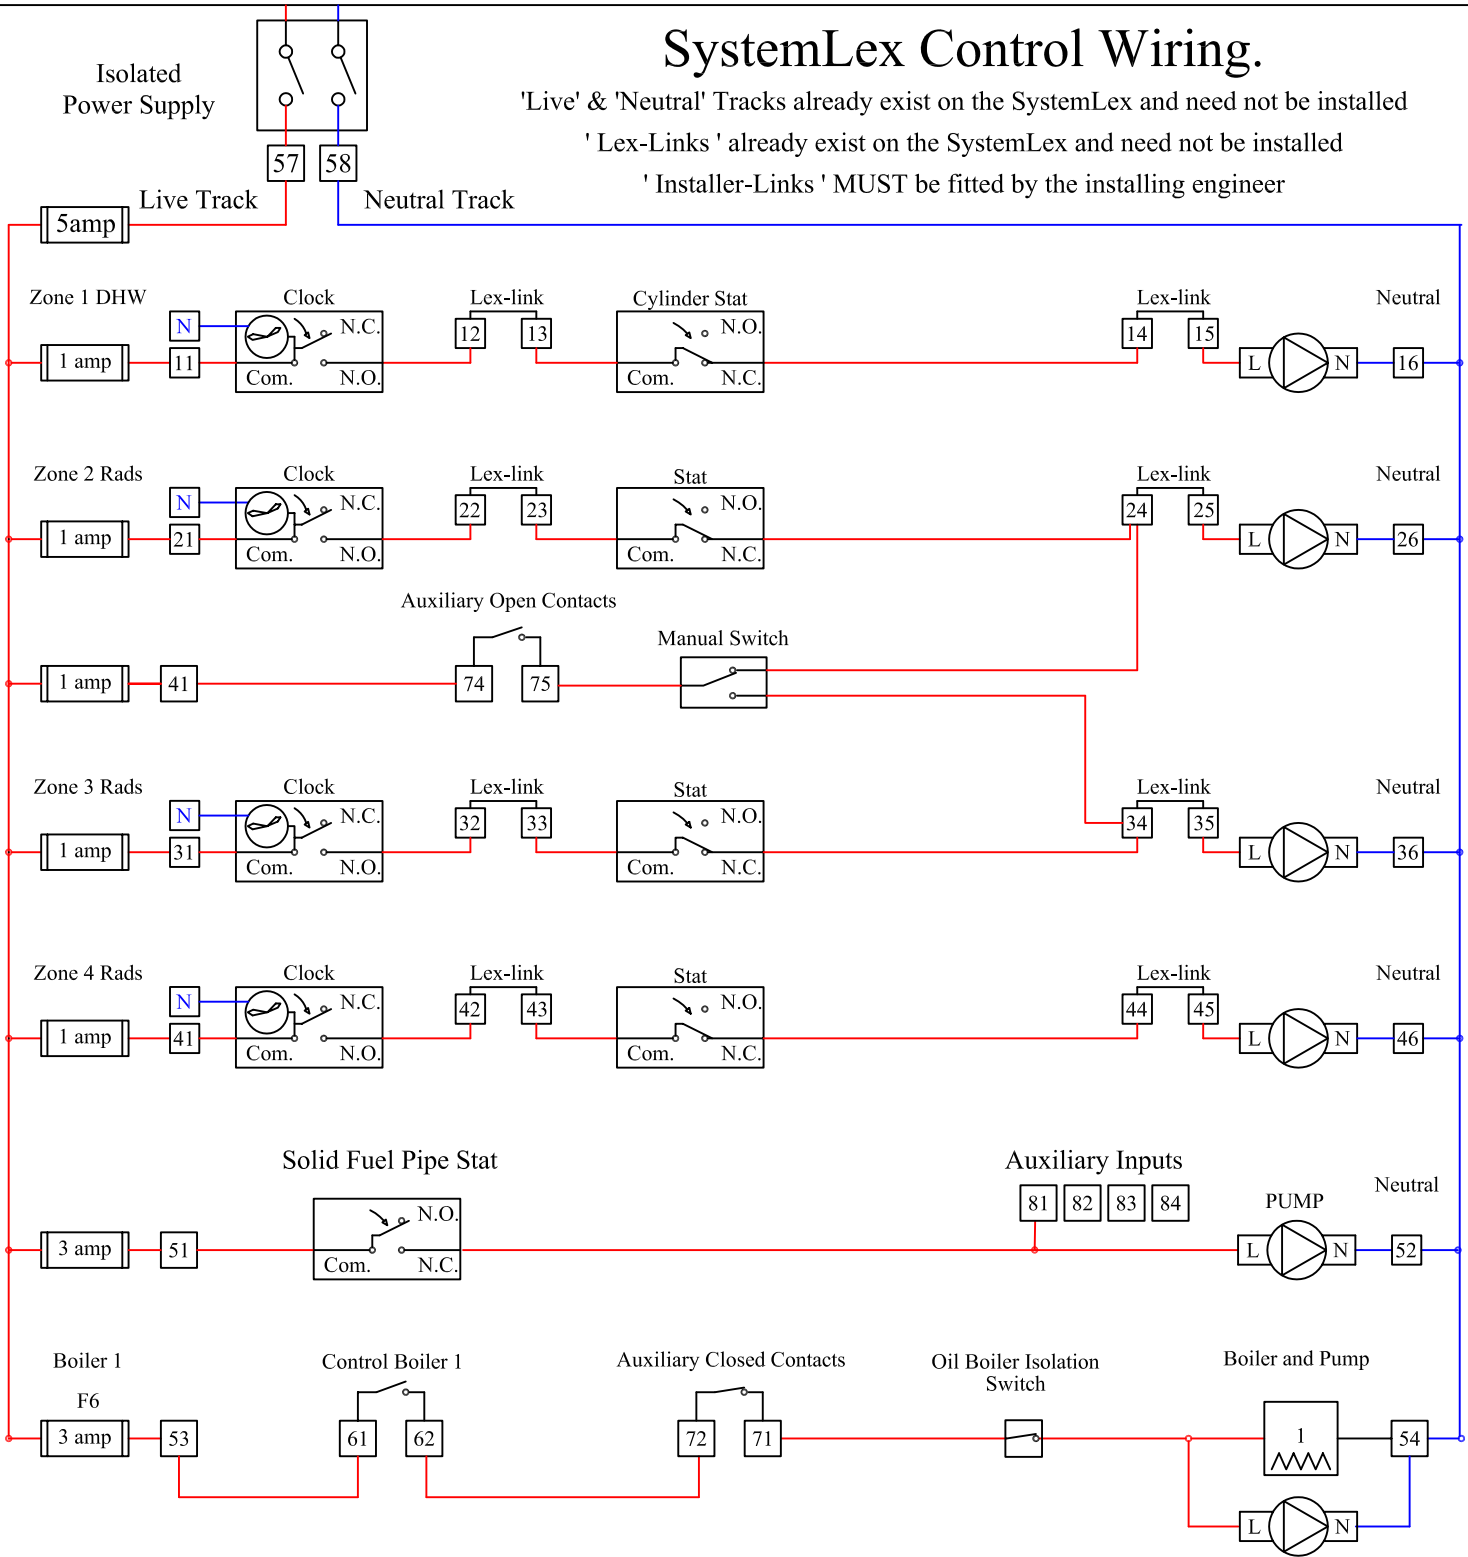

Manual Switch allows choice to dump
heat to one zone or another

<div>SystemLink C2 South City Business Centre, Tallaght, Dublin 24 Tel: 00-353-(0)1 4031200 Fax: 00-353-(0)1 4137777 e:mail, info@systemlink.ie</div>	<div>Example - Controls Wiring Schematic with SystemLex Solid Fuel Heat Disapation to Rad Zone and Also Oil Boiler Lock-Out</div>	DETAILS	
		Scale: NTS	Rev: 001
		Drawn: MC	Date: 17-01-13

To aid diagram clarity, EARTH connections are not shown but must be installed in accordance with manufacturers instructions