


SystemLex Control Wiring.

'Live' & 'Neutral' Tracks already exist on the SystemLex and need not be installed
'Lex-Links' already exist on the SystemLex and need not be installed
'Installer-Links' MUST be fitted by the installing engineer

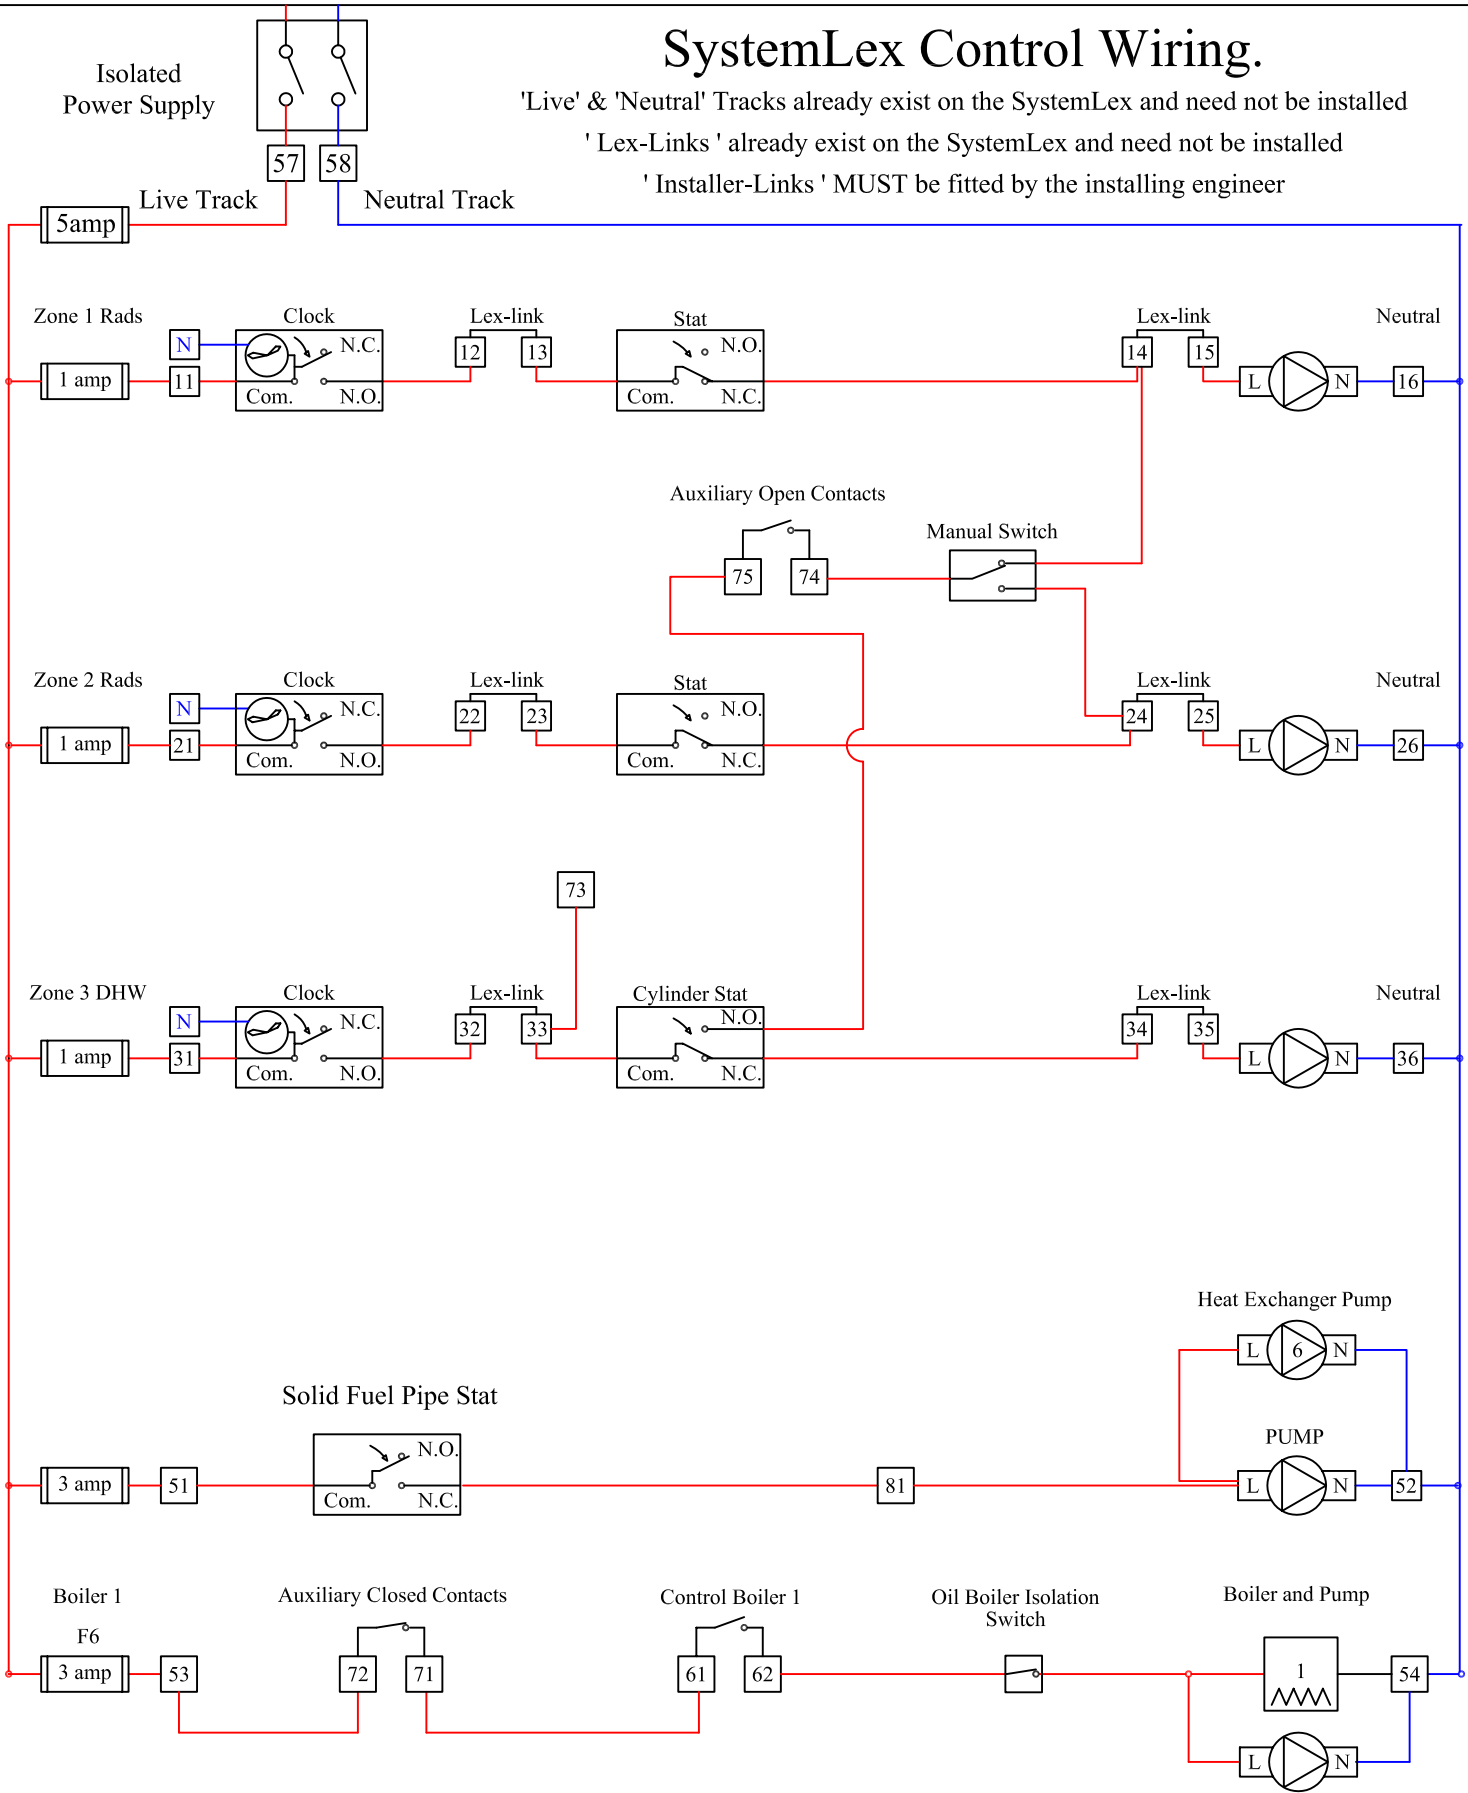

Manual Switch allows choice to dump heat to one zone or another after DHW reaches temperature.

SystemLink
Unit 1 Greenhills Business Park,
Tallaght, Dublin 24
Tel: 00-353-(0)1 4031200
Fax: 00-353-(0)1 4137777
e:mail, info@systemlink.ie

Example - Controls Wiring Schematic with SystemLex
Solid Fuel Heat Disipation and Also Oil Boiler Lock-Out

DETAILS

Scale: NTS

Rev: 001

Drawn: MC

Date: 08-01-15

To aid diagram clarity, EARTH connections are not shown but must be installed in accordance with manufacturers instructions