


SystemLex Control Wiring.

'Live' & 'Neutral' Tracks already exist on the SystemLex and need not be installed
'Lex-Links' already exist on the SystemLex and need not be installed
'Installer-Links' MUST be fitted by the installing engineer

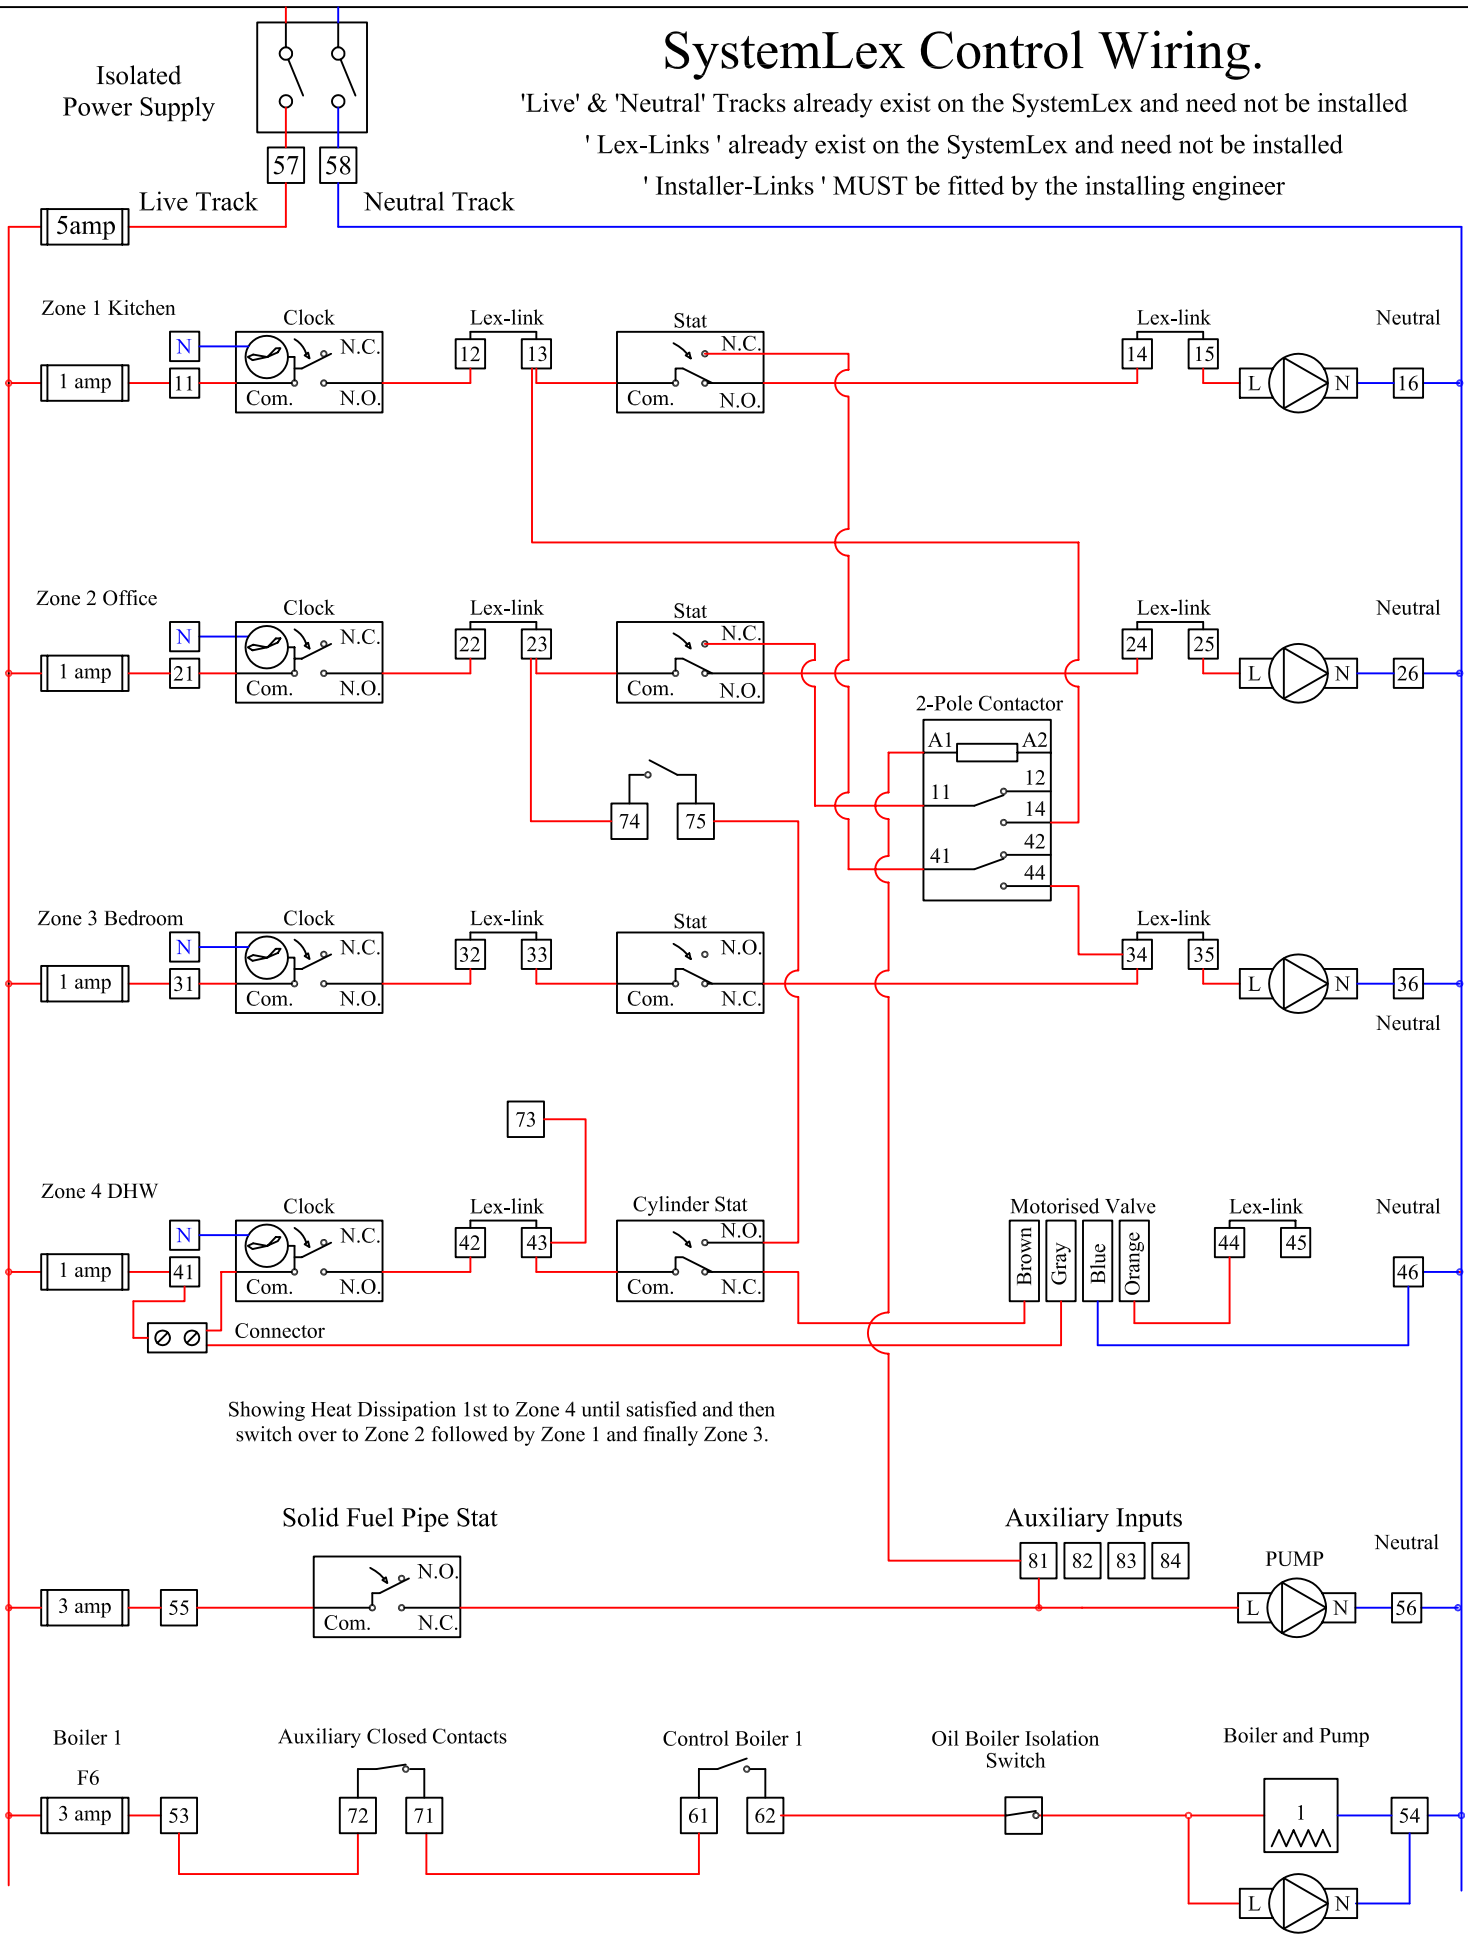

Showing Heat Dissipation 1st to Zone 4 until satisfied and then switch over to Zone 2 followed by Zone 1 and finally Zone 3.

SystemLink
C2 South City Business Centre,
Tallaght, Dublin 24
Tel: 00-353-(0)1 4031200
Fax: 00-353-(0)1 4137777
e:mail, info@systemlink.ie

Example - Controls Wiring Schematic with SystemLex
Solid Fuel Heat Disipation to Rad Zones in sequence and also
Oil Boiler Lock-Out

DETAILS

Scale: NTS

Rev: 001

Drawn: MC

Date:

To aid diagram clarity, EARTH connections are not shown but must be installed in accordance with manufacturers instructions